

Biomass boiler rooms



before




after

Reconstruction of fossil fuels boiler rooms into pellet-firing ones and energy efficiency measures in schools, health care institutions and other public buildings and pilot private houses

Operation and service of biomass boiler rooms in BIOMASA member municipalities

Sales of heat to final consumers

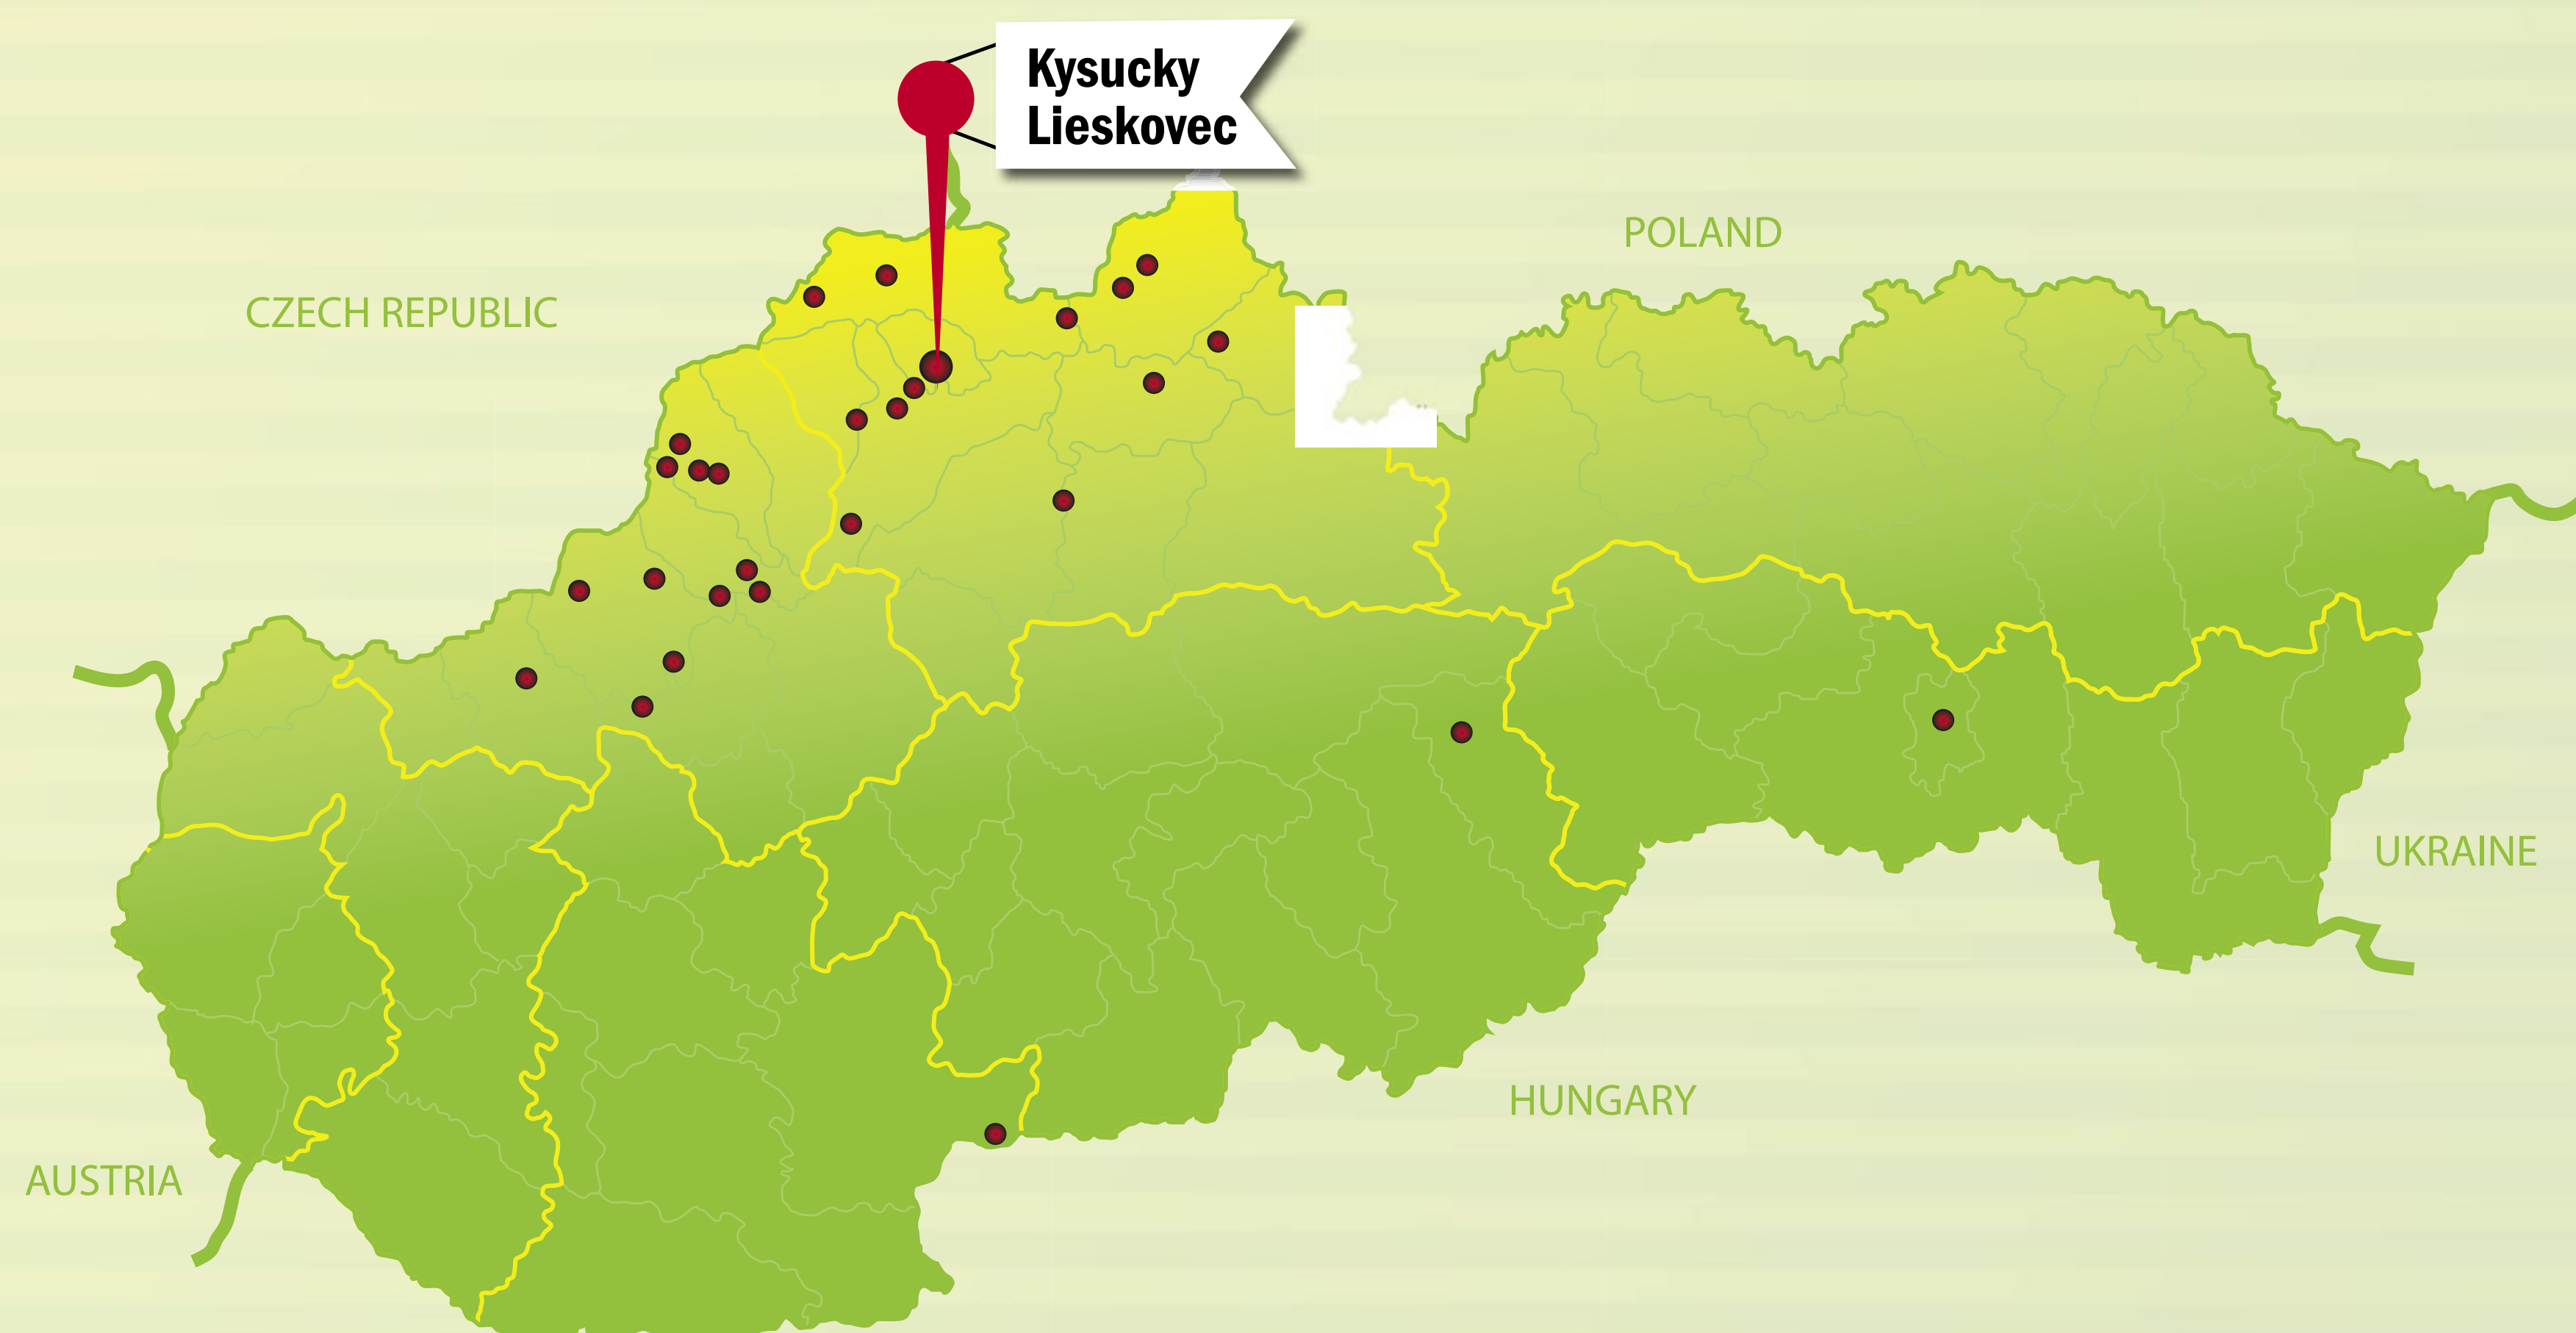

Installed output	Number of boiler rooms
up to 25 kW	13
50 - 300 kW	18
425 kW - 1 MW	12
Over 1 MW	1

Location	Northwest Slovakia
	Above all in small municipalities

Investment costs	3,3 million EUR
-------------------------	-----------------

Fuel consumption	4 000 tons of pellets annually
-------------------------	--------------------------------

Period of reconstruction	
2000	2 pilot projects
2003 - 2004	10 boilers
2005	32 boilers